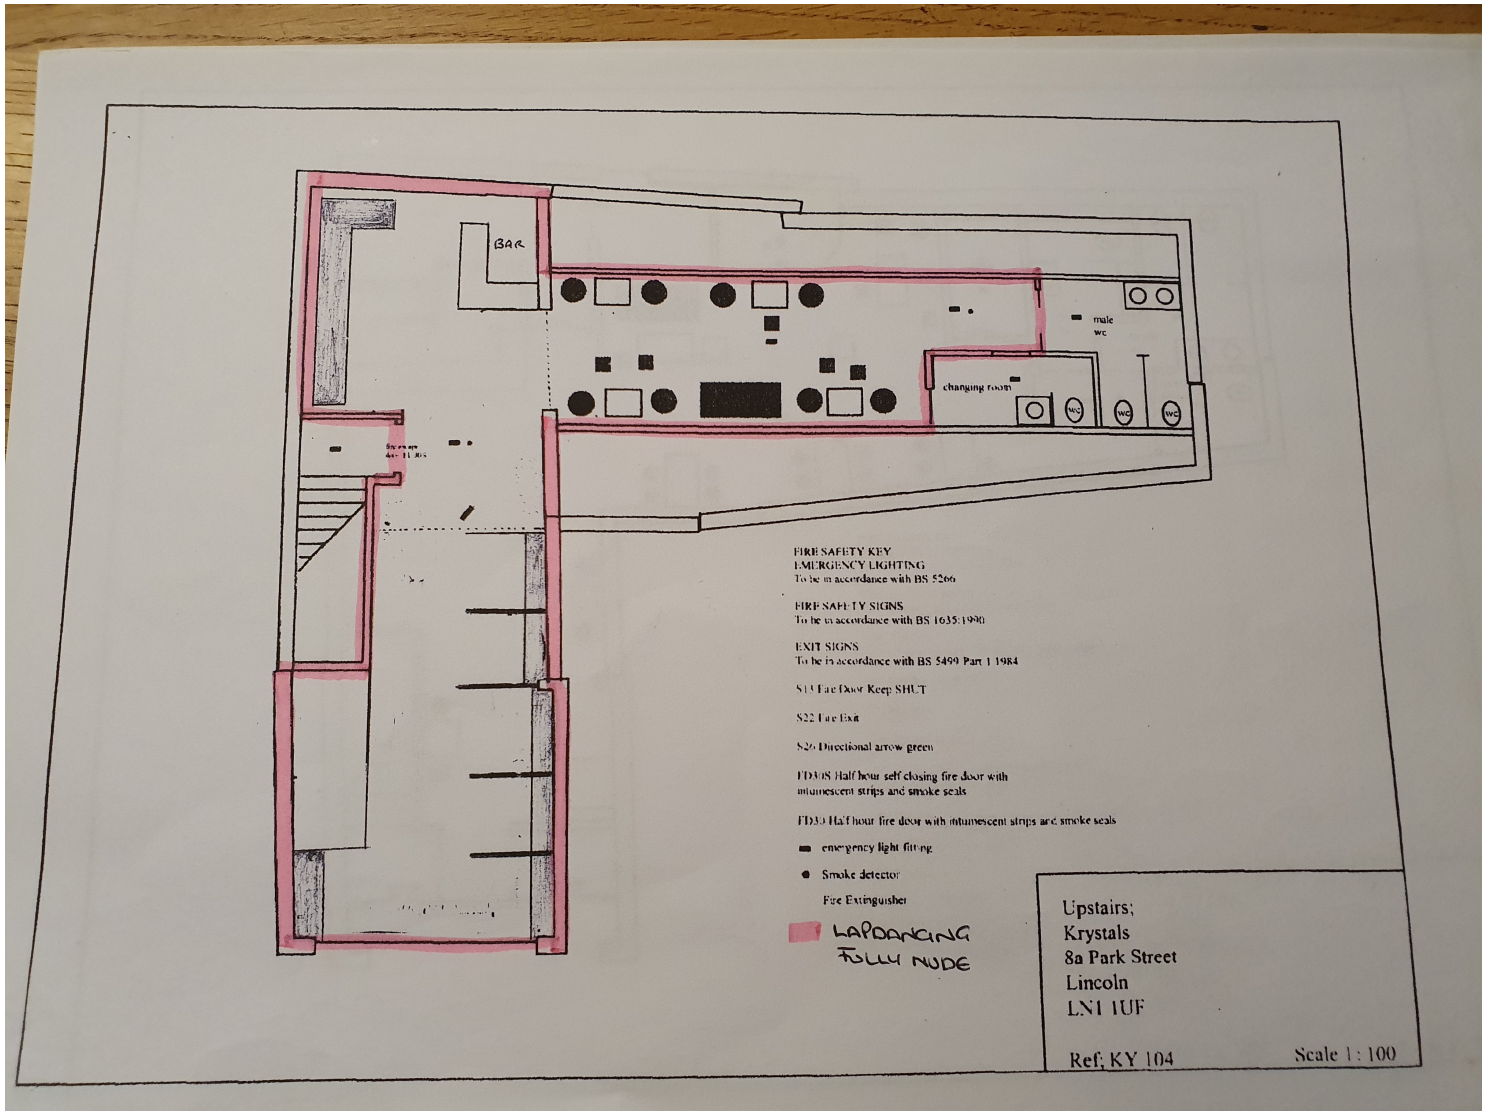
BAR
male wc
changing room
WC
WC
WC
FIRE SAFETY KEY
EMERGENCY LIGHTING
To be in accordance with BS 5266
FIRE SAFETY SIGNS
To be in accordance with BS 1635:1990
EXIT SIGNS
To be in accordance with BS 5499 Part 1 1984
S21 Fire Door Keep SHUT
S22 Fire Exit
S26 Directional arrow green
FD30S Half hour self closing fire door with intumescent strips and smoke seals
FD30 Half hour fire door with intumescent strips and smoke seals
emergency light fitting
Smoke detector
Fire Extinguisher
LAPDANCING
FULLY NUDE
Upstairs;
Krystals
8a Park Street
Lincoln
LN1 1UF
Ref; KY 104
Scale 1 : 100